


Manual D (duct sizes) calculated by hand to guarantee the correct airflow is provided to each room

Collaboration with Architects and Structural Engineers to assure adequate space for mechanical systems

Large mixing boxes used to reduce turbulence and static pressure and improve airflow

Rigid trunks employed within the floor system to prevent constrictions and assure proper air delivery

Adequate grill sizes selected according to Manual T to reduce noise in every room

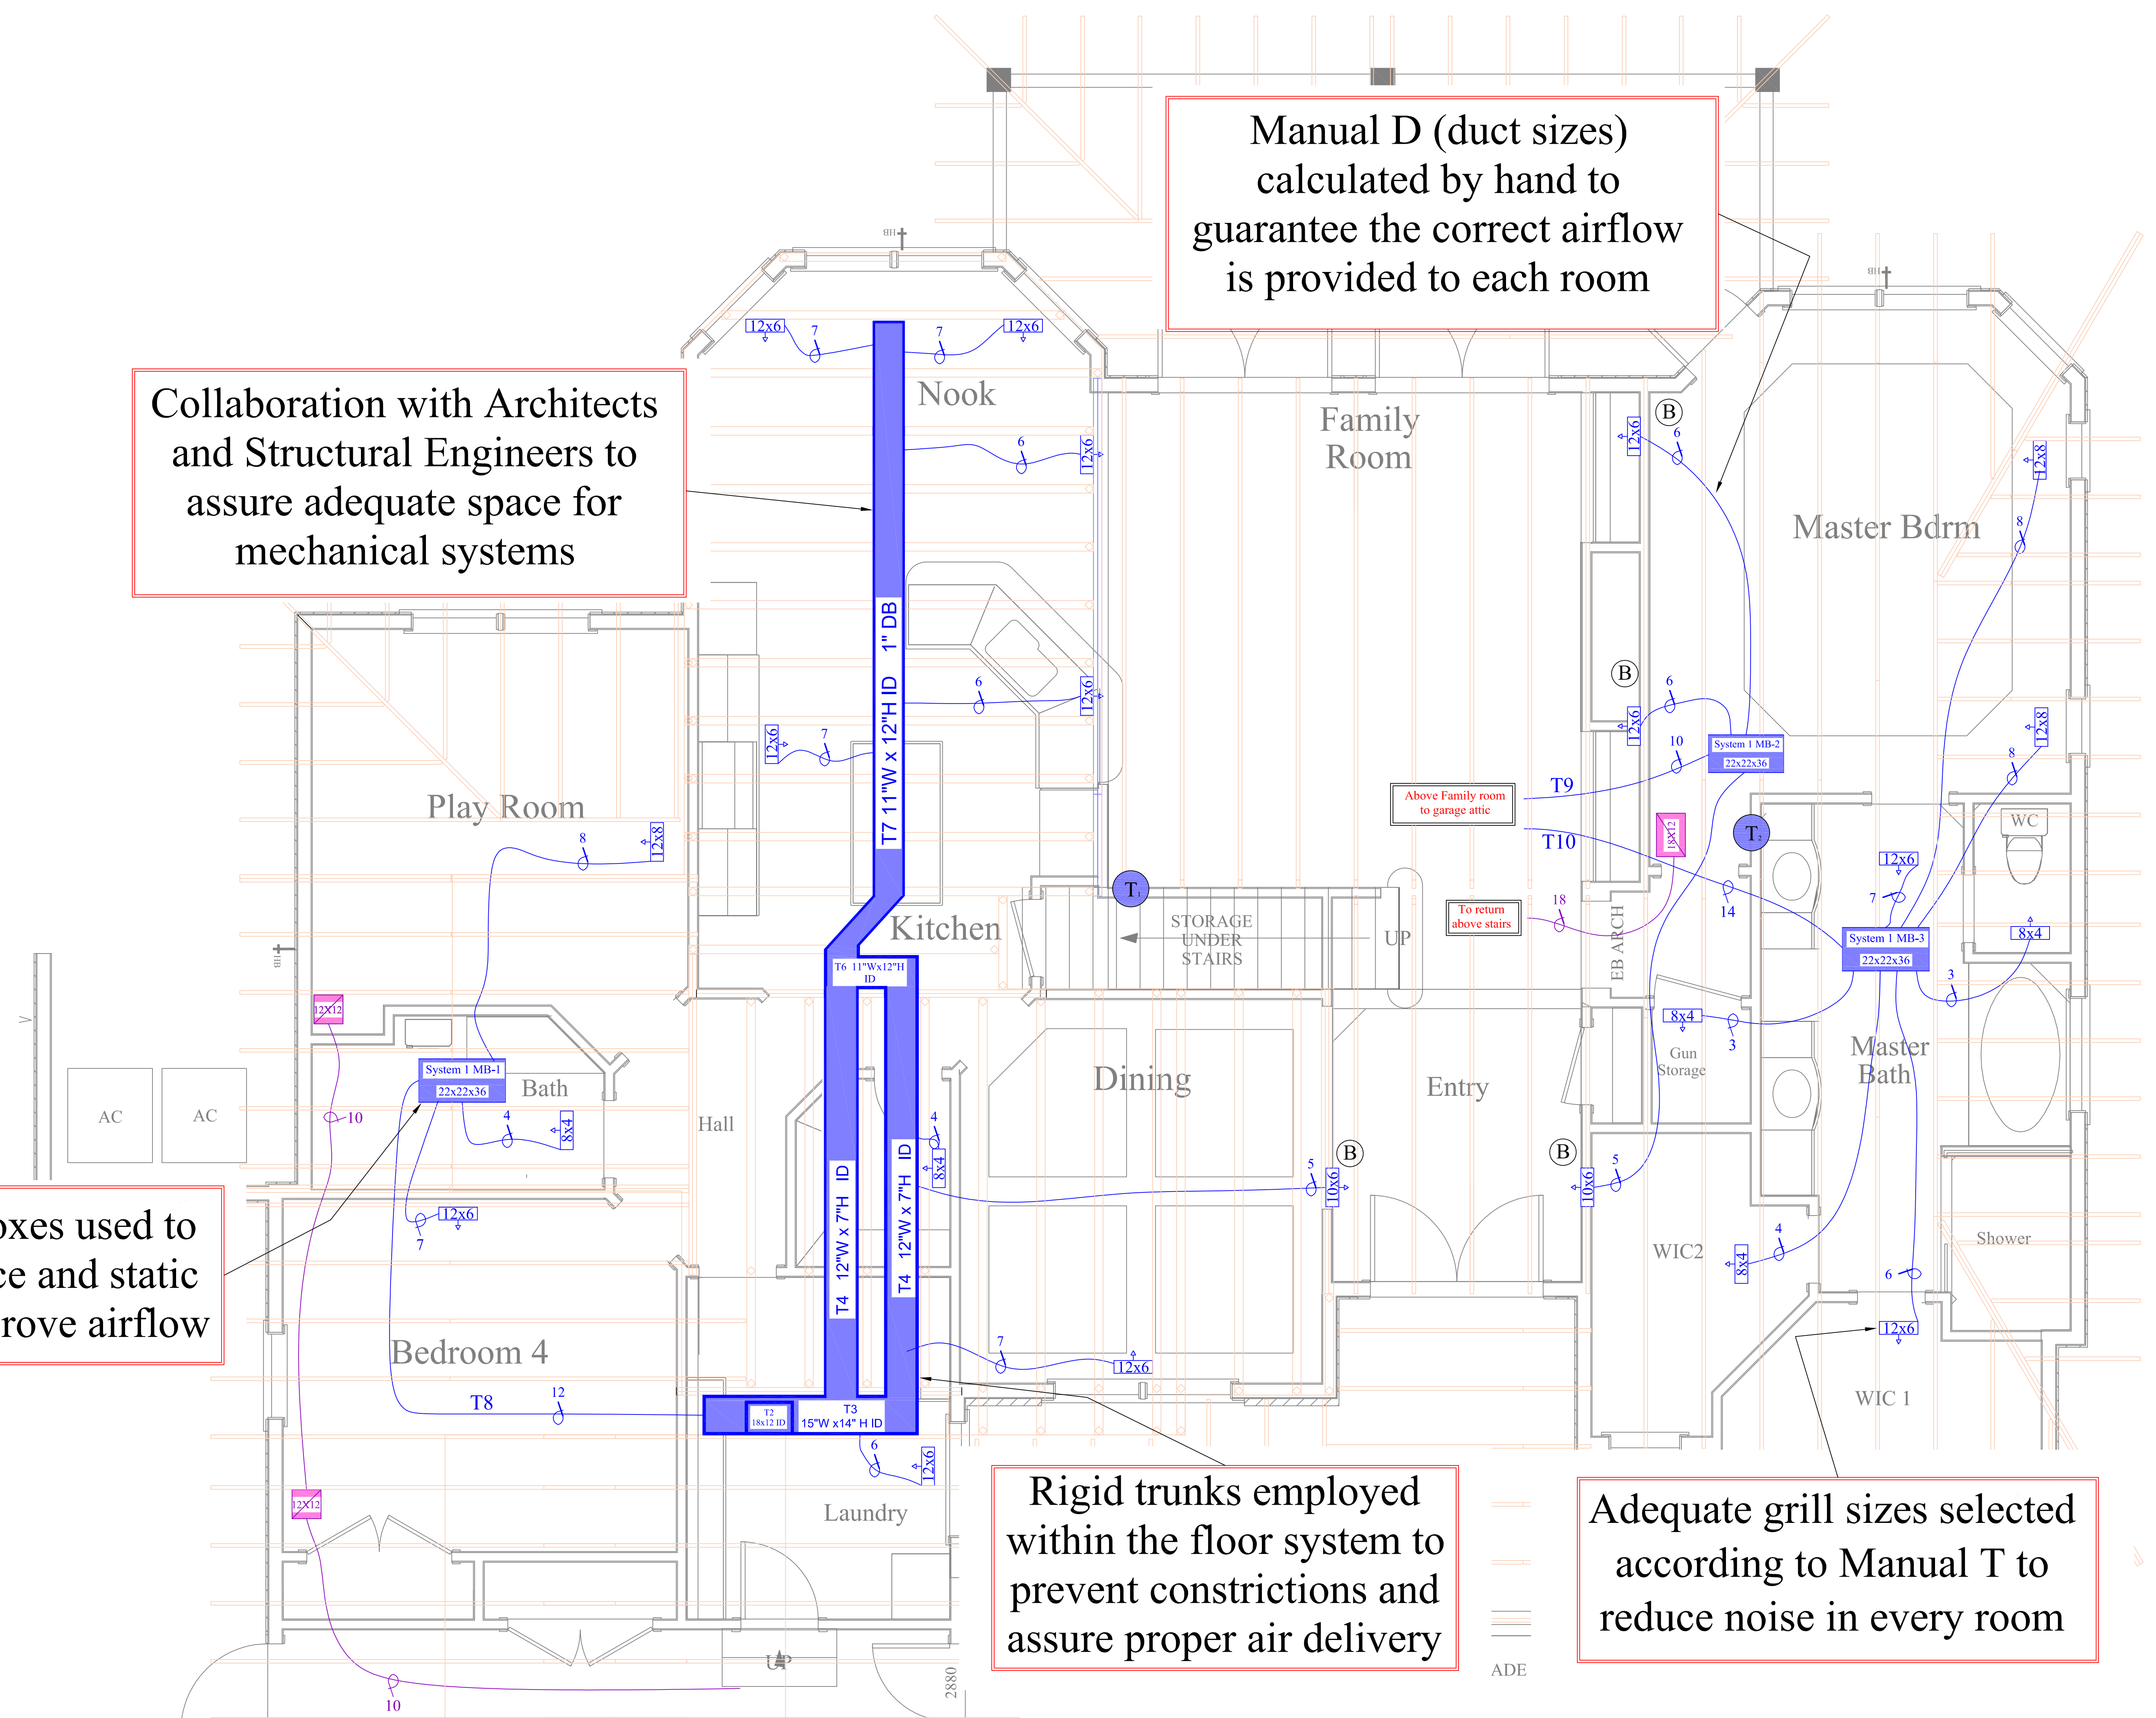

ADE